
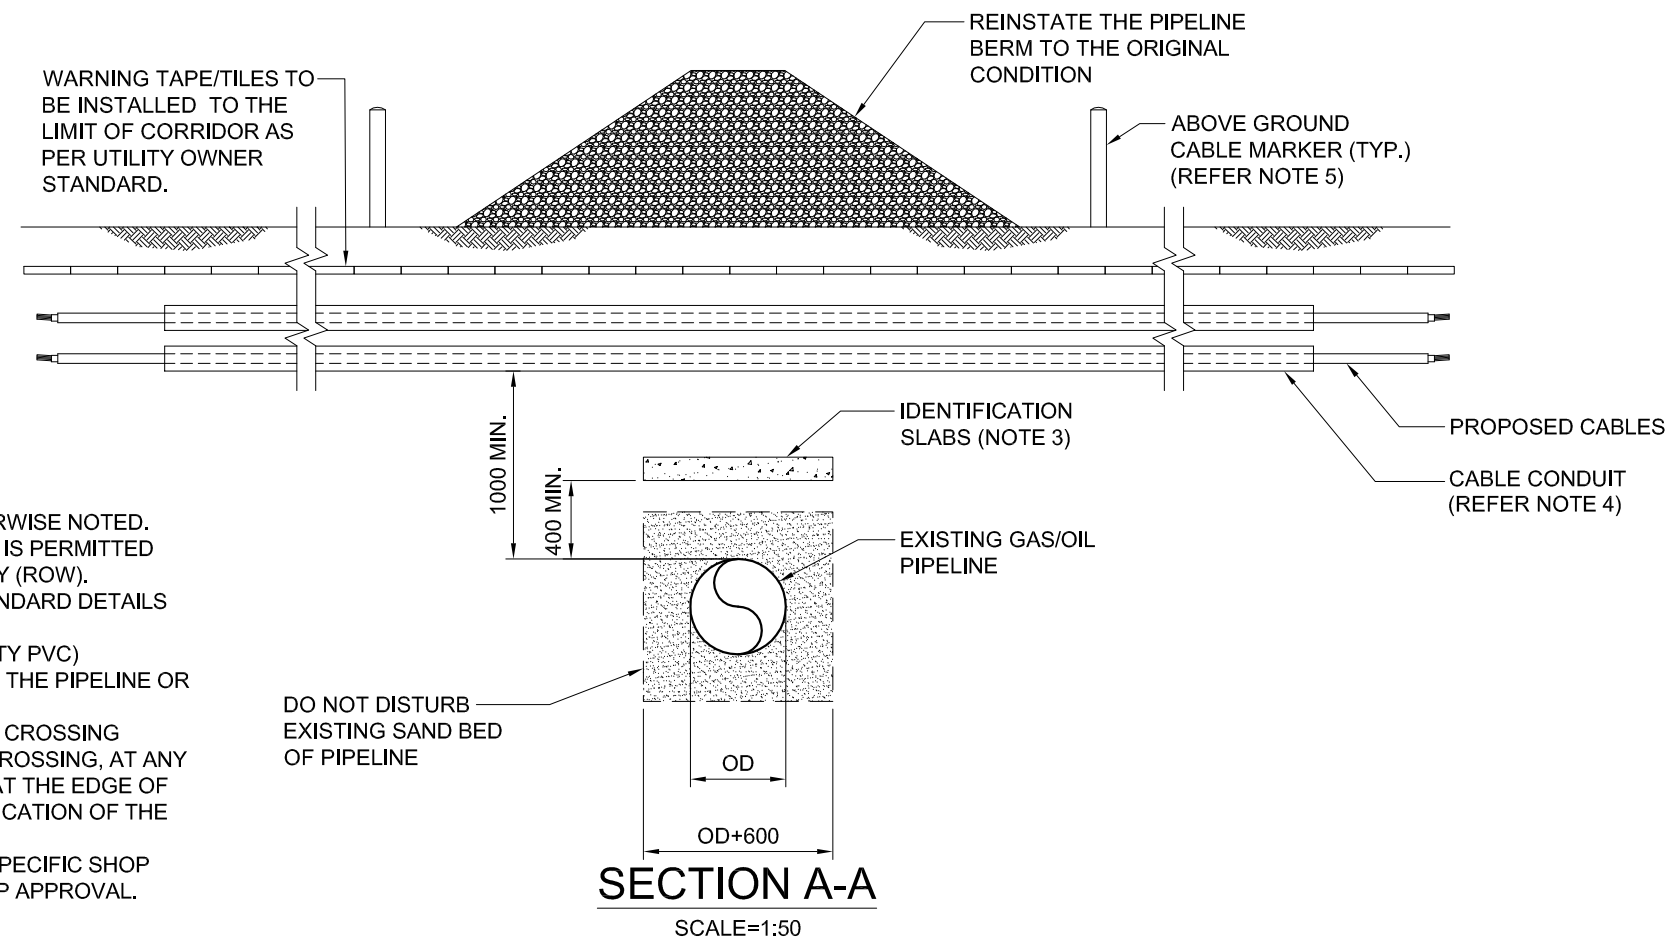


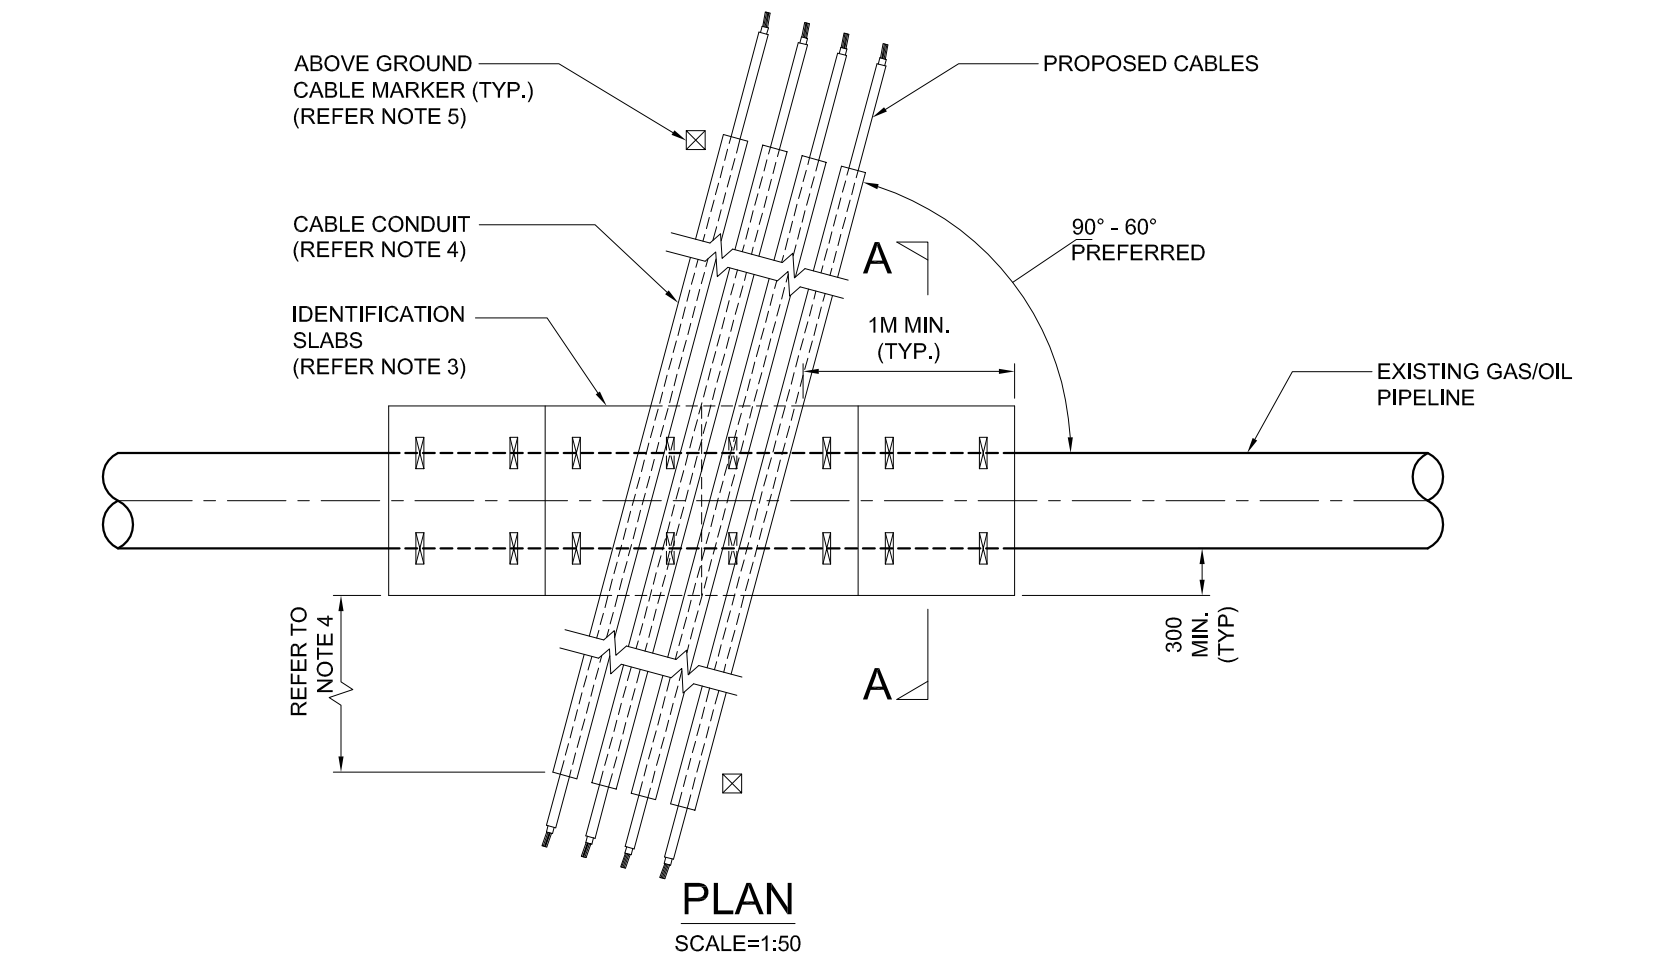

NOTES:

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE NOTED.
2. CABLE CROSSING ABOVE EXISTING GAS/OIL PIPELINE IS PERMITTED ONLY FOR CABLE LAYING WITHIN ROAD RIGHT OF WAY (ROW).
3. REFER DRAWING NUMBER DSP-GEN-90-0005-002 "STANDARD DETAILS FOR PIPELINE IDENTIFICATION SLAB".
4. CABLE CONDUIT OR DUCT BANK (HDPE OR HEAVY DUTY PVC) EXTENDING A MINIMUM OF 6 METERS EITHER SIDE OF THE PIPELINE OR FULL WIDTH OF CORRIDOR, WHICHEVER IS GREATER.
5. UTILITY OWNER'S STANDARD UNDERGROUND UTILITY CROSSING SIGNS MUST BE INSTALLED AT EITHER SIDE OF THE CROSSING, AT ANY CHANGE OF DIRECTION WITHIN THE CORRIDOR AND AT THE EDGE OF THE PIPELINE CORRIDOR TO ASSIST FUTURE IDENTIFICATION OF THE CROSSING.
6. THE CONTRACTOR SHALL PREPARE SEPARATE JOB SPECIFIC SHOP DRAWING USING THIS STANDARD DETAILS FOR DUSUP APPROVAL.
7. DELETED.

							 Dubai Supply Authority			STANDARD DRAWING CABLE CROSSING ABOVE EXISTING PIPELINE																																
2				14.09.2026																																						
1				03.02.2025																																						
0				25.01.2022																																						
										CAD File Name			Size		Scale		Area Code			Doc Code		Serial No.			Sheet of			Sheets			Rev. No.											
INFORMATION CLASSIFICATION: OPEN				Rev.			Date			Revision Description			Drawn			Checked		Approved		900-08-057-001-R2 CABLE CROSSING ABOVE PL.DWG			A3		AS SHOWN		9 0 0			0 8		0 5 7			0 0 1			0 0 1			2	